



Electric Switch




Single Channel Reciever




2) Common
4) Radiator ON

PLEASE NOTE: The receiver units are mains powered and requires either a separate 3A fused spur or connection directly into the boiler if the boiler is powered from a 3A fused spur.

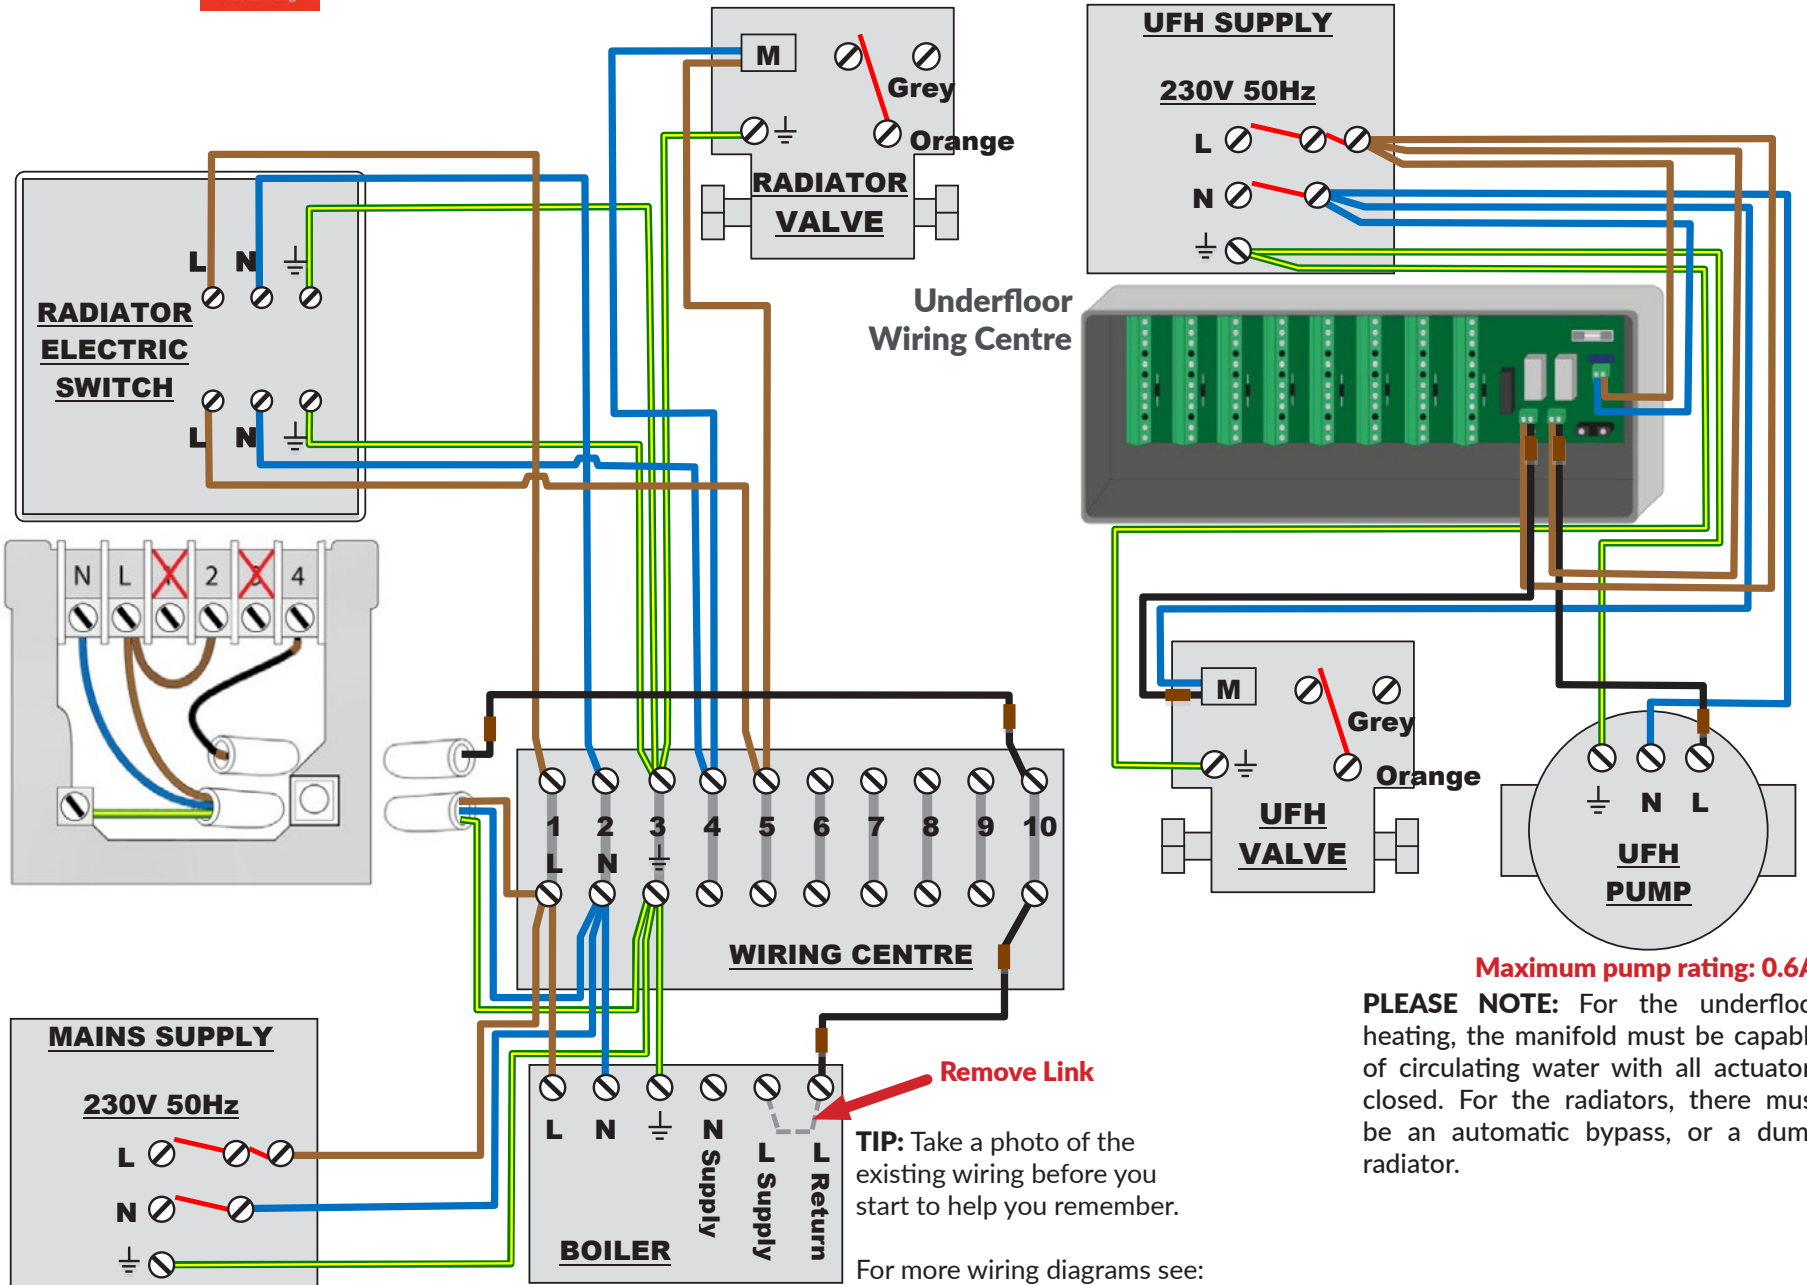


Maximum pump rating: 0.6A

PLEASE NOTE: For the underfloor heating, the manifold must be capable of circulating water with all actuators closed. For the radiators, there must be an automatic bypass, or a dump radiator.

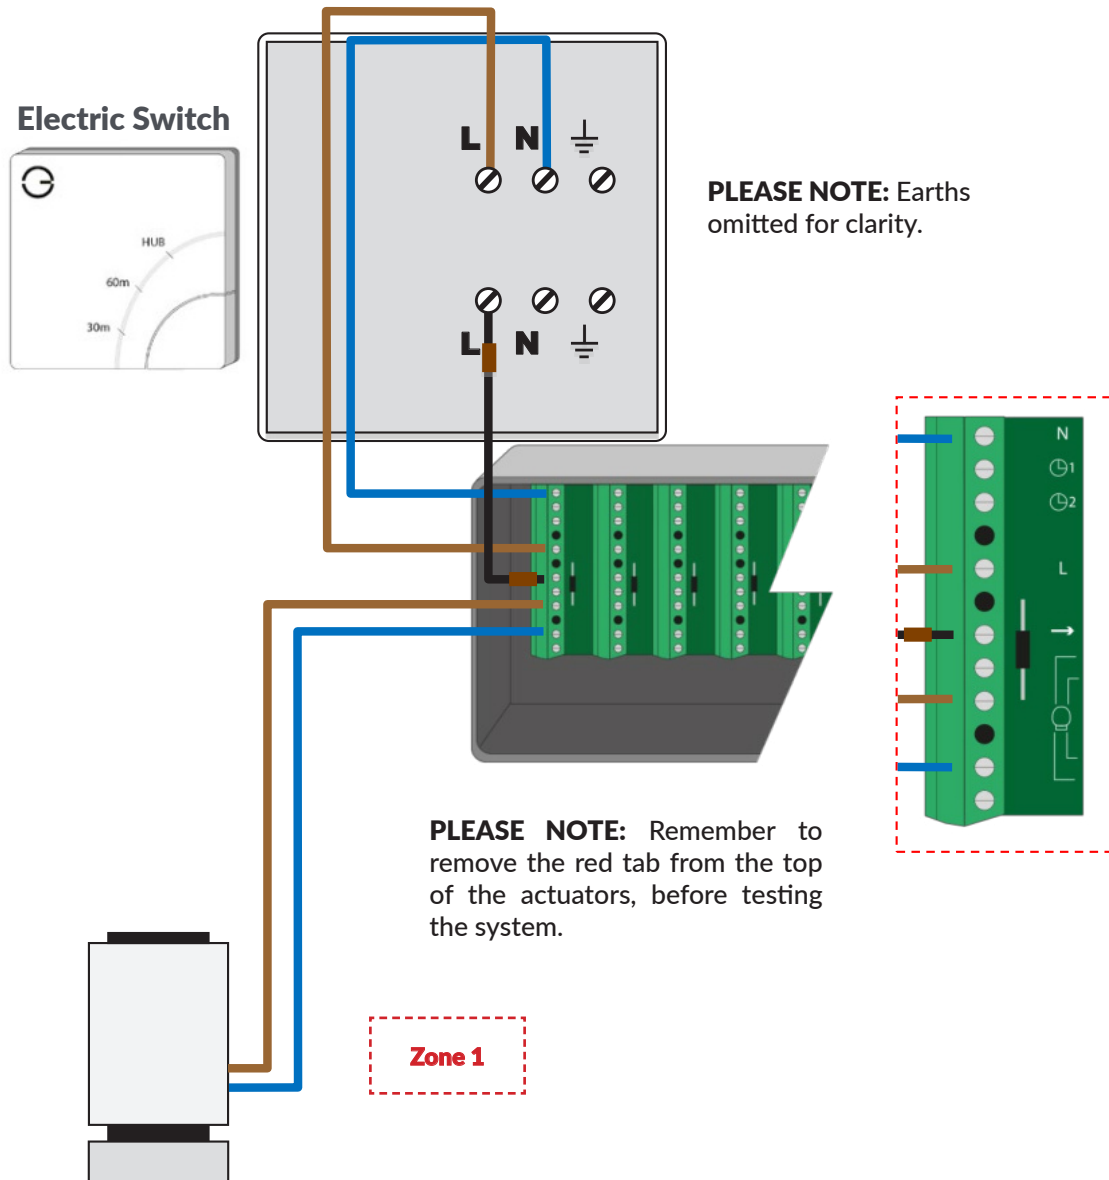

Internal Wiring Diagrams

Single Channel Receiver



Electric Switch

